



D-25 Underground Utility Conduit Trench Installation Detail

TYPICAL TRENCH CROSS-SECTION WITH STACKED CONDUIT CONFIGURATION
(N.T.S.)

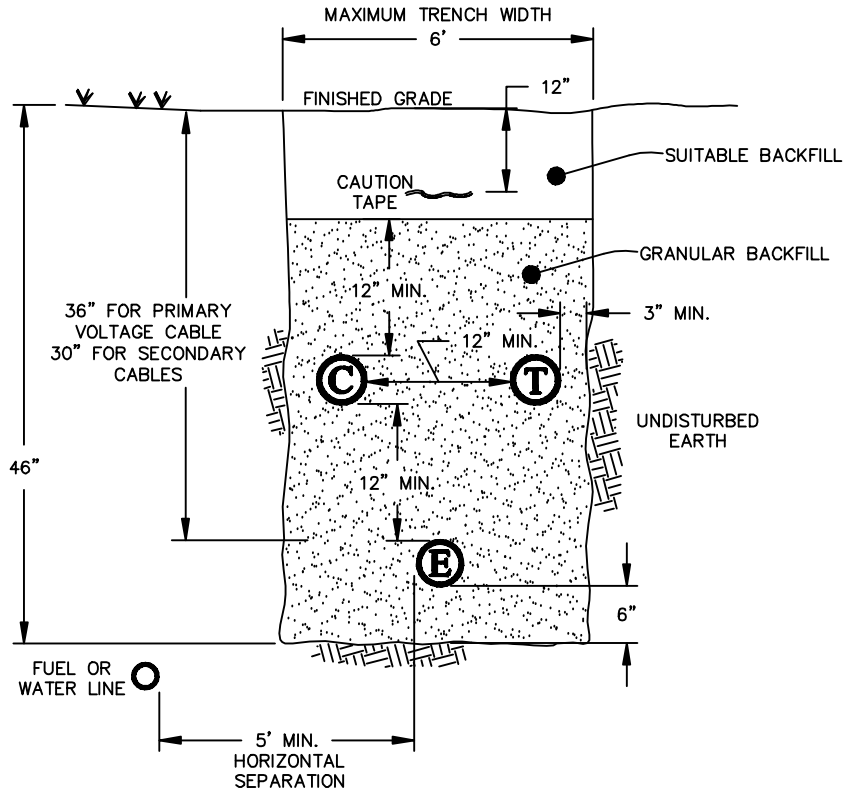

TYPICAL TRENCH CROSS-SECTION WITH SIDE-BY-SIDE CONDUIT CONFIGURATION
(N.T.S.)

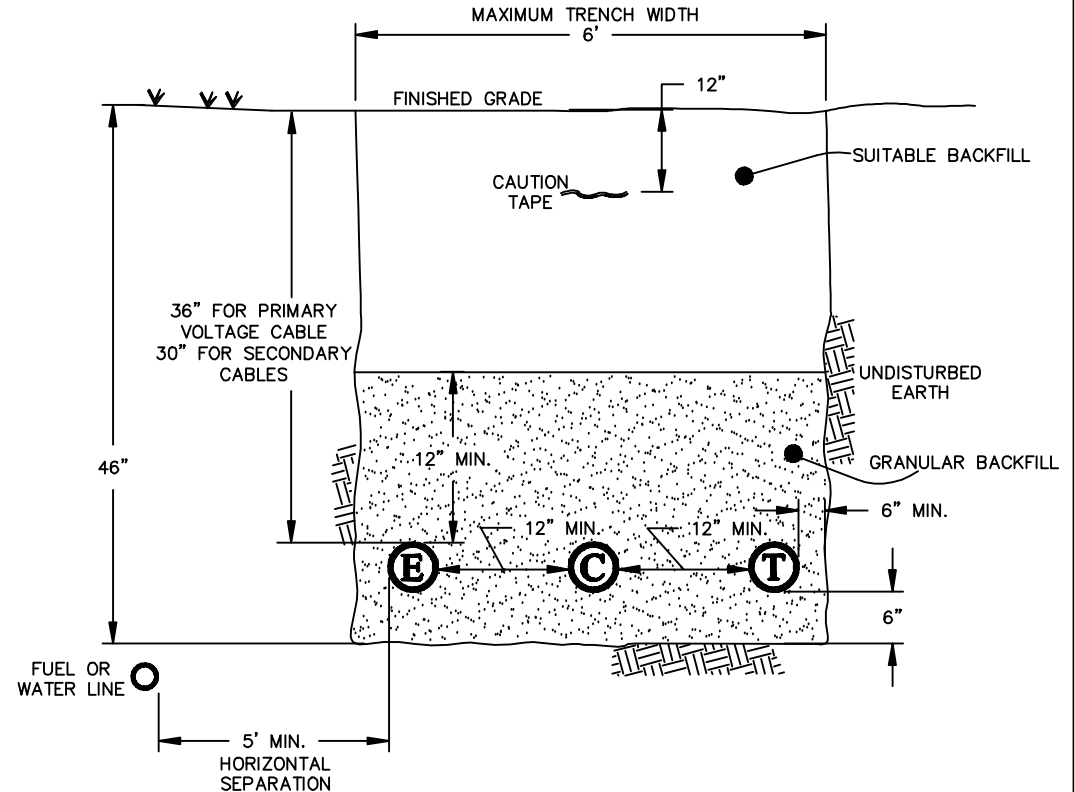

NOTE: THESE STANDARDS ARE TO BE CONSIDERED AS MINIMUM REQUIREMENTS. ANY DEVIATION FROM THESE STANDARDS WILL REQUIRE THE LACONIA DEPT. OF PUBLIC WORKS APPROVAL.



Department of Public Works

27 Bisson Avenue Phone: 603-528-6379
Laconia, NH 03246 Fax: 603-527-1298